


DASSANCE AUDITORIUM SEATING DIAGRAM SEATING CAPACITY 355 REG, 25 REQUESTABLE OVERFLOW (DENOTED IN YELLOW)

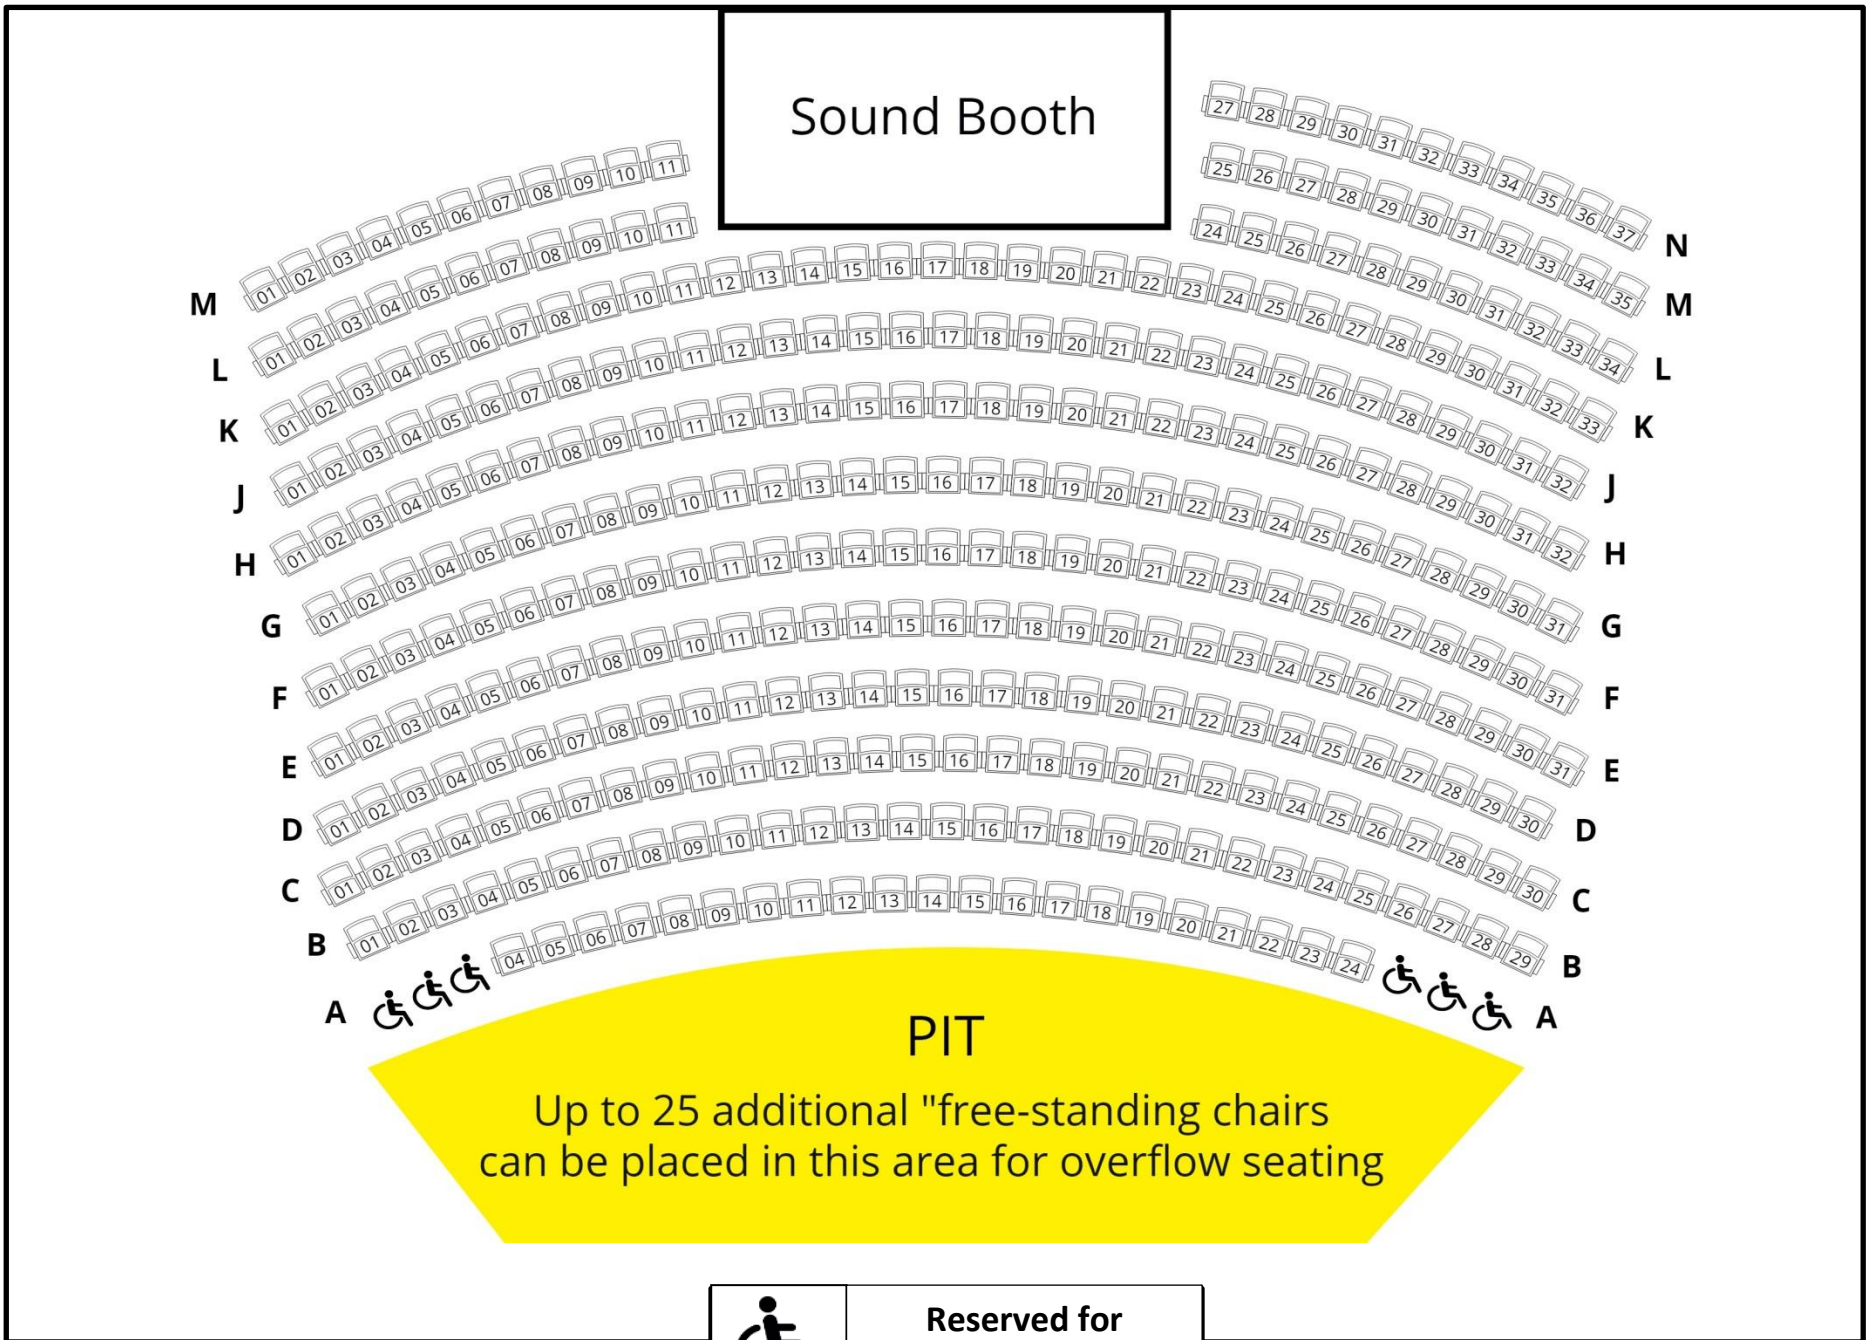

Sound Booth

M

L

K

J

H

G

F

E

D

C

B

A

N

M

L

K

J

H

G

F

E

D

C

B

A

PIT

Up to 25 additional "free-standing chairs
can be placed in this area for overflow seating



Reserved for
ADA Seating